


Existing Power Pedestal




New Power Pedestal



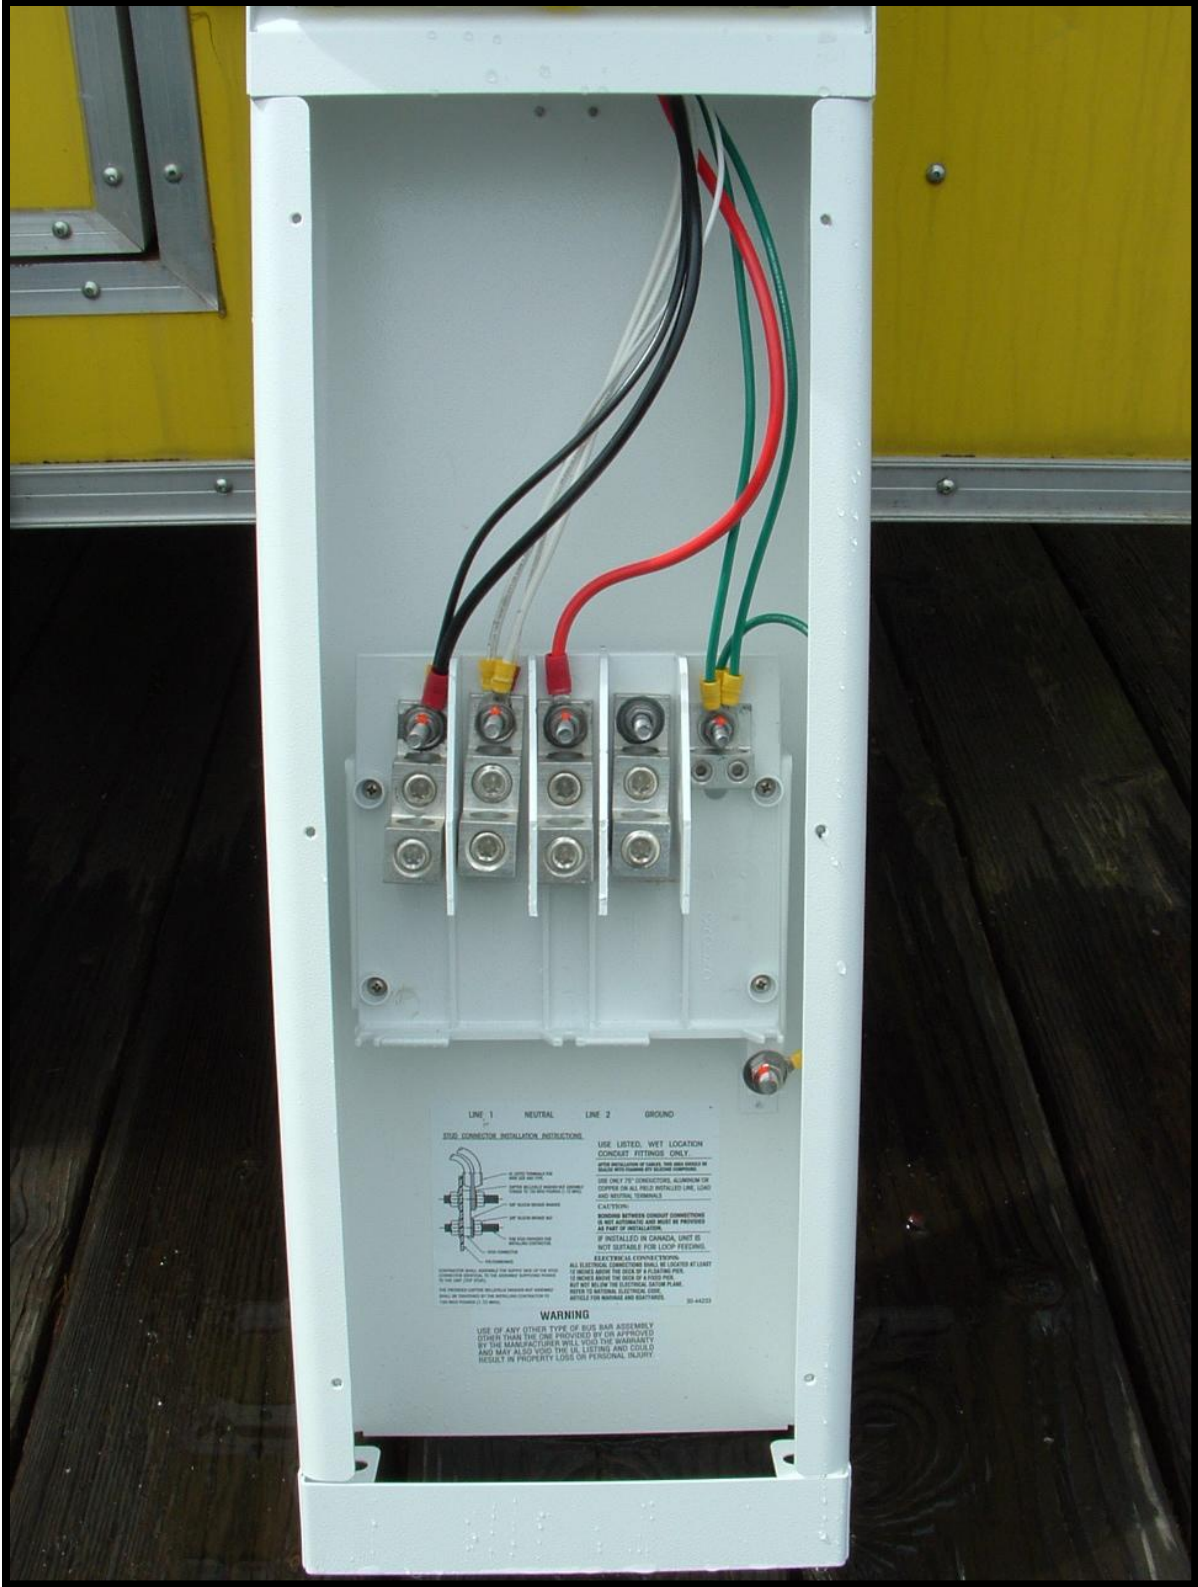

LINE 1 NEUTRAL LINE 2 GROUND

WIRE CONNECTOR INSTALLATION INSTRUCTIONS



USE LISTED, WET LOCATION CONDUIT FITTINGS ONLY

DO NOT USE CONDUIT FITTINGS THAT ARE NOT LISTED FOR WET LOCATIONS OR FOR USE WITH THIS ASSEMBLY.

USE ONLY THE CONDUIT FITTINGS LISTED IN THE INSTRUCTIONS FOR THIS ASSEMBLY.

CAUTION:

WARNING: NEVER CONNECT CONDUIT FITTINGS TO ANY ELECTRICAL SYSTEM AS PART OF INSTALLATION.

IF INSTALLED IN CANADA, UNIT IS NOT SUITABLE FOR LOOP FEEDING.

ELECTRICAL CONNECTIONS:

ALL ELECTRICAL CONNECTIONS SHALL BE LOCATED AT LEAST 12 INCHES ABOVE THE BACK OF A WET PANEL.

12 INCHES ABOVE THE BACK OF A WET PANEL. SEE THE INSTRUCTIONS FOR THIS ASSEMBLY.

SEE THE INSTRUCTIONS FOR THIS ASSEMBLY.

SEE THE INSTRUCTIONS FOR THIS ASSEMBLY.

SEE THE INSTRUCTIONS FOR THIS ASSEMBLY.

SEE THE INSTRUCTIONS FOR THIS ASSEMBLY.

SEE THE INSTRUCTIONS FOR THIS ASSEMBLY.

SEE THE INSTRUCTIONS FOR THIS ASSEMBLY.

SEE THE INSTRUCTIONS FOR THIS ASSEMBLY.

SEE THE INSTRUCTIONS FOR THIS ASSEMBLY.

SEE THE INSTRUCTIONS FOR THIS ASSEMBLY.

WARNING

USE OF ANY OTHER TYPE OF BUS BAR ASSEMBLY OTHER THAN THE ONE PROVIDED BY OR APPROVED BY THE MANUFACTURER WILL VOID THE WARRANTY AND MAY ALSO VIOLATE THE UL LISTING AND COULD RESULT IN PROPERTY LOSS OR PERSONAL INJURY.

30-44223



FOR SHORE POWER ONLY

LIGHT CIRCUIT BREAKERS
TURN TO OFF POSITION
BEFORE SERVICING
THE LOAD

FOR SHORE POWER ONLY

DANGER
HAZARD OF ELECTRICAL SHOCK
OR BURN - DISCONNECT POWER
TO UNIT BEFORE SERVICING
MANUFACTURED BY
MARINA POWER AND LIGHTING, INC.
WILLIAMSBURG, VIRGINIA
1-800-723-8099

SML0767970001

**POWER
OUTLET
40RF**
30-44283